




LOCATION PLAN

SCALE: 1"=1000'


GENERAL INSTALLATION NOTES:

1. DIMENSIONS SHOWN ARE APPROXIMATE AND SHALL BE VERIFIED IN FIELD. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS PERTINENT TO THE WORK OF THIS CONTRACT IN THE FIELD.
2. WORK TO BE DONE IN STRICT ACCORDANCE TO THESE PLANS. CHANGES REQUIRE ENGINEER REVIEW AND APPROVAL.
3. THE CONTRACTOR SHALL COORDINATE WITH THE TOWN ENGINEER, TOWN DPW, OCWA PRIOR TO INSTALLATION FOR INSPECTION REQUIREMENTS AND NOTIFICATION PRIOR TO CONNECTION.
4. CORRECTING MATERIAL/PRODUCT DEFICIENCIES IS THE RESPONSIBILITY OF THE MANUFACTURE/SUPPLIER. WORKMANSHIP IS THE RESPONSIBILITY OF THE INSTALLER. THE UNDERSIGNED ENGINEER DOES NOT GUARANTEE OR WARRANTEE EITHER OF THE ABOVE.
5. NO GUARANTEE AS TO THE FUNCTIONALITY OR LIFE EXPECTANCY OF THE PUMP STATION IS WARRANTED OR IMPLIED BY THE ENGINEER.
6. PUMP STATION SHALL BE BY ENVIRONMENTAL ONE CORPORATION MODEL DH071-93 PROVIDING 4 GPM @ 22' TDH. THE STATION SHALL HAVE A SENTRY ALARM PANEL INCLUDED WITH THE CONTROLS.
7. VENTING OF STATION IS REQUIRED. FACTORY VENT CAN BE USED OR A REMOTE VENT CAN BE PLUMBED PER OWNER DIRECTION.
8. ELECTRICAL TO BE COMPLETED BY LICENSED ELECTRICIAN MEETING REQUIRED CODE.

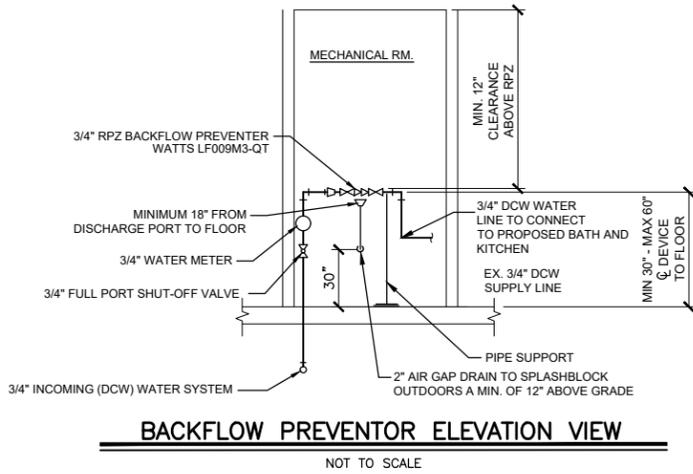


BACKFLOW PREVENTOR ELEVATION VIEW

NOT TO SCALE

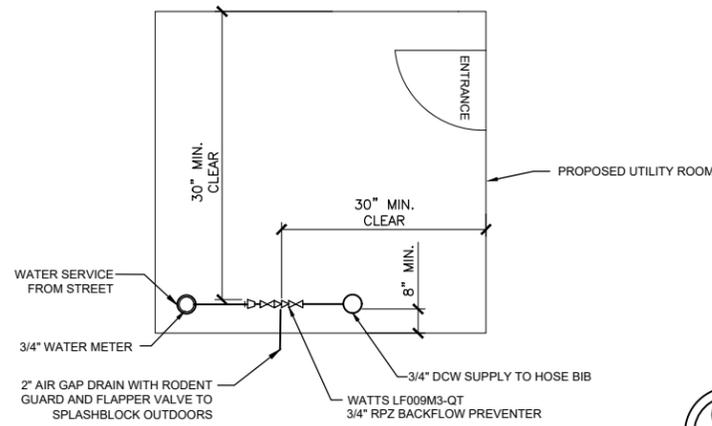

BACKFLOW PREVENTOR ENLARGED PLAN VIEW


NOT TO SCALE

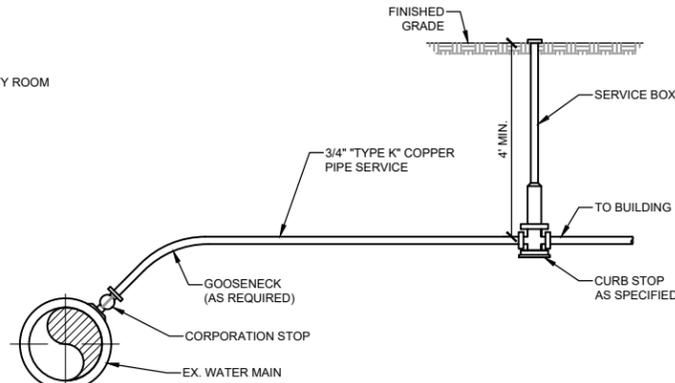

TYPICAL WATER SERVICE INSTALLATION DETAIL

NOT TO SCALE

- NOTE:**
1. SERVICE CLAMP SHALL BE PROVIDED AS REQUIRED. OCWA SHALL INSTALL SERVICE TAP.

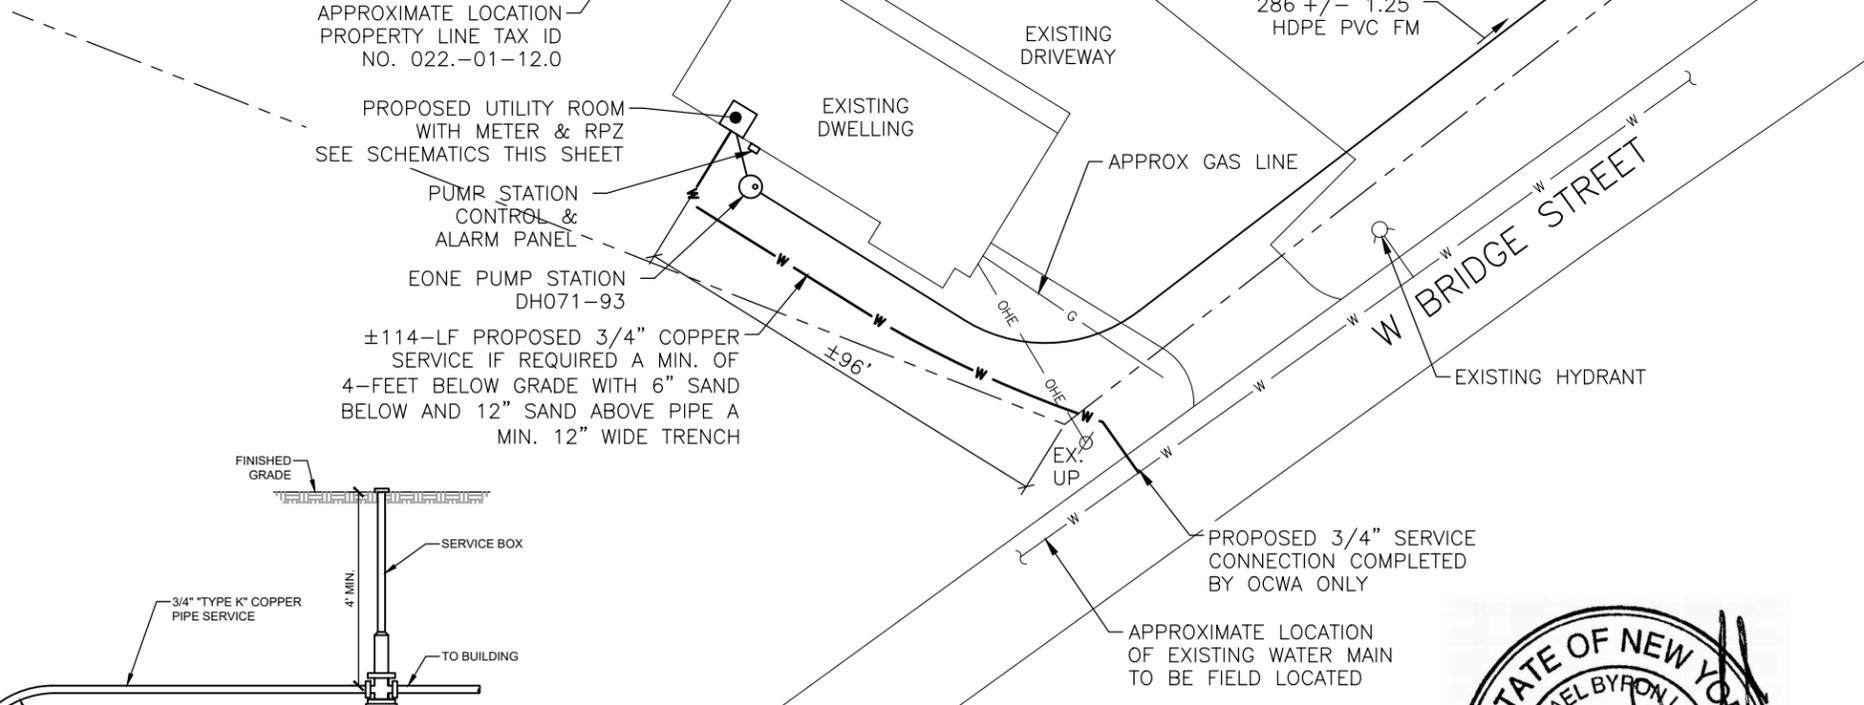

PLAN NOTES:

1. CONTRACTOR SHALL COORDINATE WITH OCWA FOR WATER CONNECTION.

PLAN

SCALE: 1"=40'



| NO. | DATE | ISSUED FOR REGULATORY REVIEW | REVISED PER OCWA COMMENTS | REVISED PER OCWA COMMENTS |
|-----|----------|------------------------------|---------------------------|---------------------------|
| A | 11/30/22 | | | |
| B | 2/15/23 | | | |
| C | 3/9/23 | | | |

WATER & WASTEWATER CONNECTION PLAN

MBL
ENGINEERING, PLLC

TOP FABRICATORS INC
2973 W. BRIDGE ST
TOWN OF LYSANDER
ONONDAGA COUNTY

PROJECT #
22-290

DATE:
NOVEMBER 2022

SHEET #
C-001

